

BS EN 14125:2013



BSI Standards Publication

Thermoplastic and flexible metal pipework for underground installation at petrol filling stations

MAHCO

National foreword

This British Standard is the UK implementation of EN 14125:2013. It supersedes BS EN 14125:2004 which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee PVE/393/6, Underground pipework systems.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2013. Published by BSI Standards Limited 2013

ISBN 978 0 580 72254 7

ICS 75.200

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 June 2013.

Amendments issued since publication

Date	Text affected
------	---------------

The logo for MAHCO is a large, stylized, light blue graphic that resembles a pipe or a structural element, composed of several overlapping shapes. Below this graphic, the word "MAHCO" is written in a large, bold, light blue serif font.

MAHCO

EUROPEAN STANDARD

EN 14125

NORME EUROPÉENNE

EUROPÄISCHE NORM

June 2013

ICS 75.200

Supersedes EN 14125:2004

English Version

Thermoplastic and flexible metal pipework for underground installation at petrol filling stations

Tuyauteries enterrées thermoplastiques et tuyauteries métalliques flexibles pour stations-service

Thermoplastische und flexible metallene Rohrleitungen für erdverlegte Installationen für Tankstellen

This European Standard was approved by CEN on 1 May 2013.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG


Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

Foreword.....	4
Introduction	5
1 Scope	6
2 Normative references	6
3 Terms and definitions	8
4 Classes and dimensions	9
4.1 Classes of pipework	9
4.2 Fittings	9
4.3 Dimensional tolerances	9
5 Physical properties	10
5.1 Pressure	10
5.1.1 General	10
5.1.2 Hydrostatic pressure	10
5.1.3 Vacuum	10
5.1.4 Cyclic pressure	11
5.2 Estimated working life	11
5.3 Temperature	11
5.4 Mechanical tests	11
5.4.1 Crush test	11
5.4.2 Bend radius test	12
5.4.3 Impact test	12
5.4.4 Puncture test	12
5.4.5 Pull test	12
5.5 Fuel tests	13
5.5.1 Fuel compatibility	13
5.5.2 Fuel permeability	13
5.5.3 Swelling	13
5.6 Static electricity	14
5.6.1 General	14
5.6.2 Requirements for insulating plastic pipe systems	14
5.6.3 Requirements for plastic pipe systems with conductive or dissipative linings	14
5.7 Weathering	14
5.8 Corrosion resistance	14
5.9 Summary of tests	15
6 Production control	15
7 Testing	16
7.1 General items referring to the test methods	16
7.1.1 Selection of test samples from a product range	16
7.1.2 Number of samples	16
7.1.3 Tests following conditioning	16
7.1.4 Combined tests	17
7.1.5 Procedure for retesting	17
7.1.6 Test Fuels	17
7.2 Test methods	18
7.2.1 Hydrostatic pressure	18
7.2.2 Vacuum test	18
7.2.3 Cyclic pressure test	19
7.2.4 Crush test	19
7.2.5 Bend radius test	19

7.2.6	Impact test.....	20
7.2.7	Puncture resistance	20
7.2.8	Fuel compatibility test	21
7.2.9	Fuel permeability test	22
7.2.10	Longitudinal swelling.....	22
7.2.11	Pull-out test.....	23
7.2.12	Fitting Pull-out test.....	23
8	Markings on pipe and fittings	23
9	Manuals	24
9.1	Product manual	24
9.2	Installation manuals.....	25
10	Records	25
Annex A (informative) A-deviations		26
Annex B (informative) Static Electricity.....		28
B.1	General	28
B.2	Delivering fuels to underground tanks	29
B.2.1	Systems with metal pipes.....	29
B.2.2	Systems with plastic pipes.....	29
Bibliography.....		32

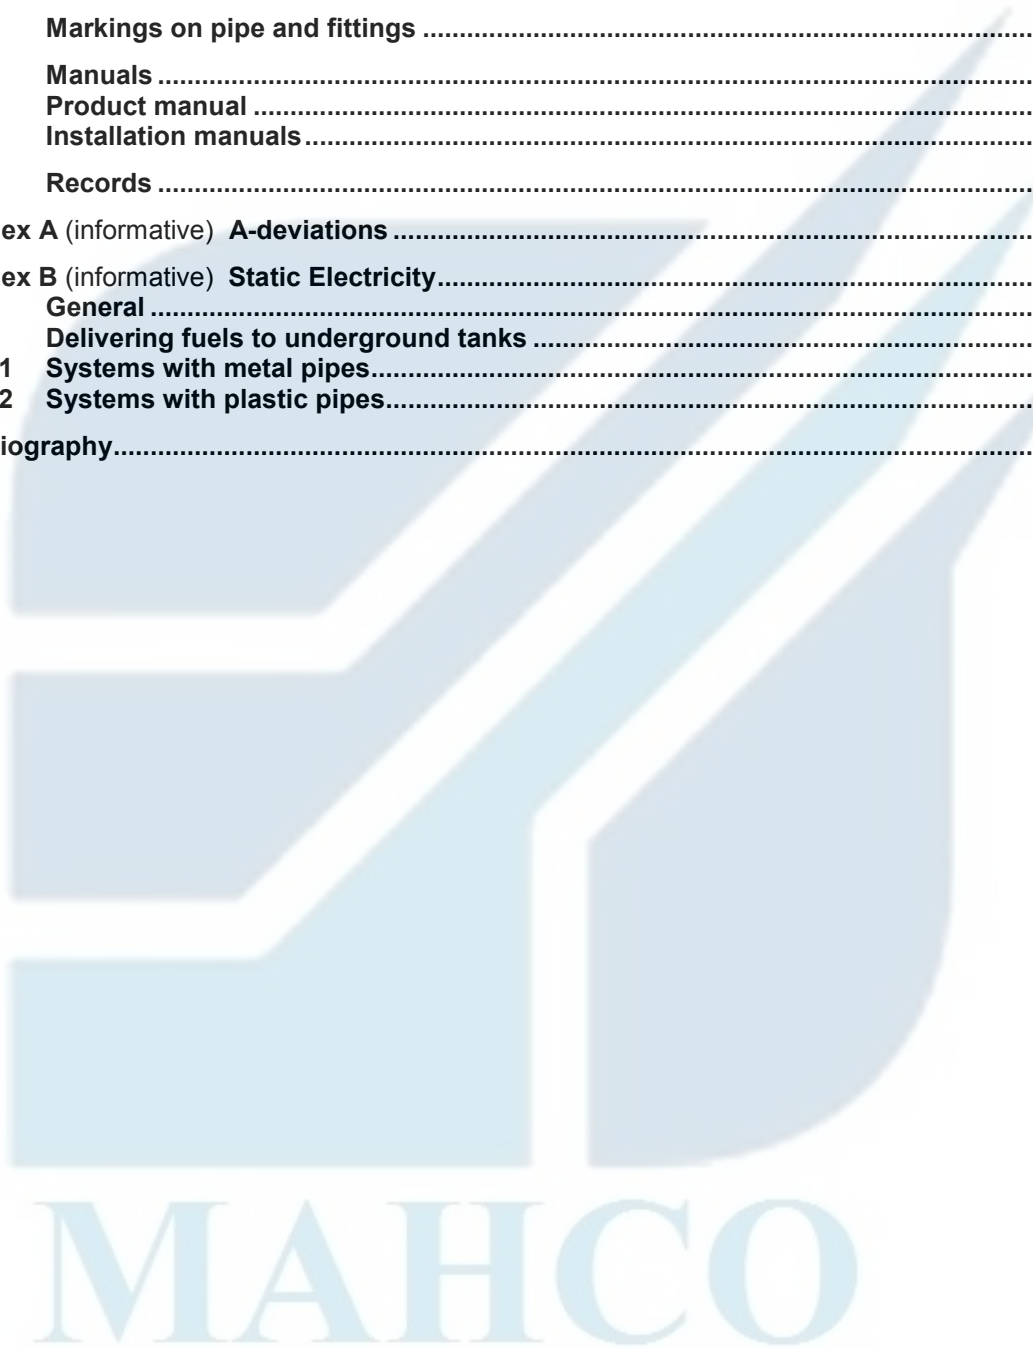

Foreword

This document (EN 14125:2013) has been prepared by Technical Committee CEN/TC 393 “Equipment for storage tanks and for filling stations”, the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by December 2013, and conflicting national standards shall be withdrawn at the latest by December 2013.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 14125:2004.

Compared with the 2004 edition and the amendment dated 2006 the following fundamental changes are given:

- new definitions included;
- new types of secondary containment included;
- multilayer pipes included;
- requirements for static electricity revised;
- new test fuels added;
- test procedures revised;
- A-deviation for the Netherlands added.

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

MAHCO

Introduction

The purpose of this document is to ensure the suitability of underground pipework for conveying liquid fuels and their vapours at petrol filling stations.

Pipework should have a designated means of fitting specified by the manufacturer or supplier.

Pipework for underground installation at petrol filling stations generally has a diameter less than 100 mm and is therefore outside the scope of the Pressure Equipment Directive (PED) 97/23/EC. Pipework with an internal diameter greater than or equal 100 mm could be within the scope of the PED.



1 Scope

This European Standard specifies requirements for underground pipework systems used to transfer liquid fuels and their vapours at petrol filling stations. Minimum performance requirements covering fitness for purpose, safety and environmental protection are given.

This European Standard applies to pipework made from thermoplastics, which may include some degree of reinforcement, and to flexible metal pipework. It does not apply to fibre reinforced thermosets, commonly referred to as glass fibre reinforced plastic (GRP), nor to rigid metals.

This document applies to:

- delivery pipes from tanks to dispensers, including positive pressure, vacuum suction and siphon modes;
- fill pipes from road tankers to tanks;
- vapour recovery and vent pipework;
- pipework for secondary containment;
- fittings.

It does not apply to pipework for use with liquefied petroleum gas.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 1555-1, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 1: General*

EN 1555-2, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 2: Pipes*

EN 1555-3, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 3: Fittings*

EN 1555-4, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 4: Valves*

EN 1555-5, *Plastics piping systems for the supply of gaseous fuels — Polyethylene (PE) — Part 5: Fitness for purpose of the system*

EN 12201-1, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 1: General*

EN 12201-2, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 2: Pipes*

EN 12201-3, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 3: Fittings*

EN 12201-4, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 4: Valves*

EN 12201-5, *Plastics piping systems for water supply, and for drainage and sewerage under pressure — Polyethylene (PE) — Part 5: Fitness for purpose of the system*

- EN 12294, *Plastics piping systems — Systems for hot and cold water — Test method for leaktightness under vacuum*
- EN 12295, *Plastics piping systems — Thermoplastics pipes and associated fittings for hot and cold water — Test method for resistance of joints to pressure cycling*
- EN 13160-1, *Leak detection systems — Part 1: General principles*
- EN 13160-2, *Leak detection systems — Part 2: Pressure and vacuum systems*
- EN 13160-7, *Leak detection systems — Part 7: General requirements and test methods for interstitial spaces, leak protecting linings and leak protecting jackets*
- EN 13463-1, *Non-electrical equipment for use potentially explosive atmospheres — Part 1: Basic method and requirements*
- EN 14214, *Liquid petroleum products — Fatty acid methyl esters (FAME) for use in diesel engines and heating applications — Requirements and test methods*
- EN 15376, *Automotive fuels — Ethanol as a blending component for petrol — Requirements and test methods*
- EN 28510-1, *Adhesives — Peel test for a flexible-bonded-to-rigid test specimen assembly — Part 1: 90° peel (ISO 8510-1)*
- EN ISO 1167-1, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 1: General method (ISO 1167-1)*
- EN ISO 1167-2, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 2: Preparation of pipe test pieces (ISO 1167-2)*
- EN ISO 1167-3, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 3: Preparation of components (ISO 1167-3)*
- EN ISO 1167-4, *Thermoplastics pipes, fittings and assemblies for the conveyance of fluids — Determination of the resistance to internal pressure — Part 4: Preparation of assemblies (ISO 1167-4)*
- EN ISO 4892-2:2013, *Plastics — Methods of exposure to laboratory light sources — Part 2: Xenon-arc sources (ISO 4892-2:2013)*
- EN ISO 8510-2, *Adhesives — Peel test for a flexible-bonded-to-rigid test specimen assembly — Part 2: 180 degree peel (ISO 8510-2)*
- EN ISO 11306, *Corrosion of metals and alloys — Guidelines for exposing and evaluating metals and alloys in surface sea water (ISO 11306)*
- EN ISO 11339, *Adhesives — T-peel test for flexible-to-flexible bonded assemblies (ISO 11339)*
- EN ISO 16871, *Plastics piping and ducting systems — Plastics pipes and fittings — Method for exposure to direct (natural) weathering (ISO 16871)*
- ISO 11922-1, *Thermoplastics pipes for the conveyance of fluids — Dimensions and tolerances — Part 1: Metric series*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

- 3.1 pipework system**
pipes and fittings used to convey or retain liquid fuels and their vapours
- 3.2 fittings**
in-line connector, elbow, reducer, tee or cap, or flange or other component supplied to connect one pipe to another or pipework to equipment
- 3.3 flexible pipe**
pipe that can be bent by hand to any radius above a set minimum without any change in performance
- 3.4 primary delivery pipework**
pipework designed to convey liquid fuels by positive pressure or vacuum suction
- 3.5 fill pipework**
pipework designed to convey liquid fuels from a delivery tanker to an underground storage tank by gravity discharge
- 3.6 multilayer pipe**
pipe where more than one identified layer is present
- 3.7 vent pipework**
pipework designed to convey vapour from a storage tank to the atmosphere
- 3.8 vapour recovery pipework**
pipework designed to convey vapour (or condensate) to or from a storage tank
- 3.9 liquid fuel**
commercially available petrol and diesel fuel comprising biofuels and biofuels blends
- 3.10 leakage containment**
system which is designed to prevent leakage from a primary system entering the environment and which enables the detection of leakage
- 3.11 secondary containment**
system which is designed to achieve leakage containment
- 3.12 design pressure**
 P_d
maximum effective pressure of the fluid in the piping system, expressed in bar, which is allowed in continuous use

4 Classes and dimensions

4.1 Classes of pipework

Pipes for underground fuel distribution shall conform to one of the following two classes:

- **Class 1** — Double wall pipework capable of containing and facilitating the detection of leakage from a primary delivery pipe.
- **Class 2** — Single wall pipework.

The primary pipe of Class 1, and pipes of Class 2, shall conform to one of Types A or B. The secondary pipe of Class 1 shall conform to one of Types C1 or C2.

a) **Type A.** Plastic systems.

Pipes shall be principally made of thermoplastic polymers, with some metal or fibre reinforcement optional.

b) **Type B.** Flexible metal systems.

Pipes shall comprise a fluid tight primary pipe made of a metal.

c) **Type C.** Secondary containment.

- 1) **Type CS.** System with continuous 360° separation between the primary containment and secondary containment.
 - i) **Type CS1:** A pipe system designed to contain any leakage from the primary pipe. The system is at atmospheric pressure.
 - ii) **Type CS2:** A pipe system designed to contain any leakage from the primary pipe. The system is designed to conform to the performance criteria of Class I leak detection systems in accordance with EN 13160-1, EN 13160-2 and EN 13160-7.
- 2) **Type CP:** System without continuous 360° separation between the primary containment and secondary containment.
 - i) **Type CP1:** A pipe system designed to contain leakage from the primary pipe. The system is at atmospheric pressure.
 - ii) **Type CP2:** A pipe system designed to contain leakage from the primary pipe. The system is designed to conform to the performance criteria of Class I leak detection systems in accordance with EN 13160-1, EN 13160-2 and EN 13160-7.

4.2 Fittings

All pipework shall include fittings to provide leak-tight attachment to other systems, terminations, branches and changes of direction.

4.3 Dimensional tolerances

The external diameter and wall thickness shall be stated by the manufacturer. For plastic pipework the tolerance on the external diameter shall be in accordance with ISO 11922-1, Grade B, and the out-of-roundness shall be in accordance with ISO 11922-1, Grade N.

5 Physical properties

5.1 Pressure

5.1.1 General

Operating and test pressures shall be in accordance with Table 1 according to the application.

All pressures in Table 1 are gauge pressures.

Table 1 — Operating and test pressures for pipework

Application	Operating pressure bar	Test vacuum bar	Lower test pressure bar	Higher test pressure bar
Primary delivery pipework: positive pressure	+3,5	—	+5,0 ± 0,1	+30,0 ± 1,0
Primary delivery pipework: vacuum suction including siphons	-0,6	-0,9 ± 0,05	+5,0 ± 0,1	
Vents and vapour recovery pipework	1,0	-0,9 ± 0,05	+5,0 ± 0,1	
Fill pipework	1,0	—	+5,0 ± 0,1	
Secondary containment Type CP1 and CS1	+0,5	—	+1,0 ± 0,02	+5,0 ± 0,1
Secondary containment Type CP2 and CS2	-0,5 to +4,5	-0,6 ± 0,05	+5,0 ± 0,1	+10 ± 0,2

5.1.2 Hydrostatic pressure

This requirement applies to all pipes and fittings.

When tested in accordance with 7.2.1.1, all pipes and fittings, sampled in accordance with 7.1.2 and connected together as one or more assemblies, shall:

- withstand the lower test pressure in Table 1 for no less than 5 min with no signs of leakage.

When tested in accordance with 7.2.1.2, all pipes and fittings, sampled in accordance with 7.1.2 and connected together as one or more assemblies, shall:

- withstand the lower test pressure in Table 1 for no less than 5 min with no signs of leakage;
- withstand the higher test pressure in Table 1 for no less than 1 min with no signs of leakage.

5.1.3 Vacuum

This requirement applies to all pipes and fittings intended for vacuum suction, including siphons, vent and vapour recovery and secondary containment, Type CP2 and CS2.

When tested in accordance with 7.2.2, all pipes and fittings, sampled in accordance with 7.1.2, shall:

- withstand the vacuum specified in Table 1 for no less than 30 min. The loss of vacuum shall not exceed 0,05 bar and there shall be no signs of collapse.

5.1.4 Cyclic pressure

This requirement applies to pipes and fittings for all applications except secondary containment.

When tested in accordance with 7.2.3, a sample of pipes and fittings selected in accordance with 7.1.1 and 7.1.2 shall withstand the test conditions without leakage.

5.2 Estimated working life

Design plans shall be available for all pipework which demonstrate that the pipework is designed to have an estimated working life of at least 30 years.

NOTE The pressure design of polymeric pipes where only one layer contributes to the pressure rating of the pipe will be designed through a regression curve generated in accordance with EN ISO 9080. In the case of a polymeric multilayer pipe construction, where more than one layers contribute to the pressure rating of the pipe, the stress base design can be measured (procedure II) or calculated (procedure I) as defined in ISO 17456.

When tested in accordance with EN ISO 1167-1 to EN ISO 1167-4, pipes, fittings and assemblies shall not leak under the following test conditions:

- a) a 1 h hydrostatic pressure test, at (20 ± 2) °C, at 1,5 times the design pressure P_d , or at 9 bar for primary pipe and 3 bar for secondary containment Type CP2 and CS2 piping, whichever is the greater;
- b) a 1 000 h hydrostatic pressure test, at (80 ± 2) °C, at 0,8 times the design pressure P_d , or at 5 bar for primary piping and 2,6 bar for secondary containment Type CP2 and CS2 piping, whichever is the greater.

5.3 Temperature

There shall be two temperature classes:

Temperature Class T1: Underground pipework shall be fully operational between -40 °C and $+50$ °C.

Temperature Class T2: Underground pipework shall be fully operational between -20 °C and $+50$ °C, but suitable for transport and storage at -40 °C and $+50$ °C.

Pipework that passes the tests in 7.2.1.1, 7.2.5.3, 7.2.6 and 7.2.7.3 at the appropriate temperature shall be deemed to conform this requirement.

5.4 Mechanical tests

5.4.1 Crush test

This requirement applies to all pipes and fittings.

When tested in accordance with 7.2.4, a sample of pipes and fittings selected in accordance with 7.1.1 and 7.1.2 shall:

- recover to not less than 90 % of their original diameter within 5 min of the load being removed;
- show no visible sign of leakage or cracking;
- when tested in accordance with 7.1.3 show no signs of leakage and, where vacuum testing is specified, show no signs of collapse.

5.4.2 Bend radius test

This requirement applies to all pipes and in-line connectors.

When tested in accordance with 7.2.5, a sample of pipes and straight connectors selected in accordance with 7.1.1 and 7.1.2 shall:

- show no visible sign of leakage or cracking;
- when tested in accordance with 7.1.3 show no signs of leakage and, where vacuum testing is specified, show no signs of collapse.

The sample of pipes chosen in accordance with 7.1.1 shall include that pipe diameter for which the bending strain is greatest. The bending strain is equal to $\frac{d}{2R}$, where d is the outer diameter of the pipe and R the bending radius specified by the manufacturer.

5.4.3 Impact test

This requirement applies to all pipes and fittings.

When tested in accordance with 7.2.6, a sample of pipes and fittings selected in accordance with 7.1.1 and 7.1.2 shall:

- show no visible sign of leakage or cracking; in Type B pipes there shall be no through-thickness damage to any protective coating;
- when tested in accordance with 7.1.3 show no signs of leakage and, where vacuum testing is specified, show no signs of collapse.

5.4.4 Puncture test

This requirement applies to all pipes.

When tested in accordance with 7.2.7, a sample of pipes selected in accordance with 7.1.1 and 7.1.2 shall:

- show no visible sign of leakage or cracking;
- when tested in accordance with 7.1.3 show no signs of leakage and, where vacuum testing is specified, show no signs of collapse.

5.4.5 Pull test

This requirement applies to all pipes and straight connectors intended for positive pressure and vacuum suction applications.

When tested in accordance with 7.2.11, a sample of pipes and straight connectors selected in accordance with 7.1.1 and 7.1.2 and connected to pipes to form assemblies, shall:

- show no visible sign of slippage;
- when tested in accordance with 7.1.3 show no signs of leakage and, where vacuum testing is specified, show no signs of collapse.

The samples of pipes and fittings chosen in accordance with 7.1.1 shall include those with the lowest diameter and those with the lowest diameter > 63 mm.

5.5 Fuel tests

5.5.1 Fuel compatibility

This requirement applies to all pipes and fittings.

When tested in accordance with 7.2.8, a sample of pipes and fittings selected in accordance with 7.1.1 and 7.1.2 shall:

- show no signs of damage or swelling, for example of seals, which could impair correct functioning of the pipework;
- when tested in accordance with 7.1.3 show no signs of leakage and, where vacuum testing is specified, show no signs of collapse;
- pipes with a multi-layer construction where the layers are all flexible, shall be subjected to peel test in accordance with 7.2.8.2.1;
- pipes with a multi-layer construction where the layers are flexible-rigid shall be subjected to peel test in accordance with 7.2.8.2.2;
- In each case the mean peel strength shall be a minimum of 15 N/cm and the ratio of the mean peel strength to the unexposed samples shall be not less than 0,8.

5.5.2 Fuel permeability

This requirement applies to all pipes of Types A, CP1, CS1, CP2, CS2. Permeability classes are defined in accordance with the maximum level of permeability as stated in Table 2.

Table 2 — Maximum fuel permeability of underground pipes

Application	Fuel permeability $\text{g}\cdot\text{m}^{-2}\cdot\text{d}^{-1}$	Maximum fuel permeability $\text{g}\cdot\text{m}^{-2}\cdot\text{d}^{-1}$
Primary delivery pipework: positive pressure and vacuum suction including siphons	$0_0^{+0,2}$	—
Vents and vapour recovery pipework	—	2,0
Fill pipework	—	2,0
Secondary containment	—	24,0

When tested in accordance with 7.2.9 a sample of pipes selected in accordance with 7.1.1 and 7.1.2 shall conform to the values given in Table 2 for Test Fuel 1, Test Fuel 2, Test Fuel 3 and Test Fuel 4 (according to 7.1.6), in accordance with the application or permeability class. The sample of pipes chosen in accordance with 7.1.1 shall include the pipes with the lowest diameter having the same design.

5.5.3 Swelling

For pipes intended for positive pressure and vacuum suction delivery, the swelling when tested in accordance with 7.2.10 using Test Fuel 2 shall not exceed 0,2 %.

5.6 Static electricity

5.6.1 General

Ignition hazards by static electricity caused by fuel pipe systems shall be avoided. In 5.6.2 to 5.6.3 corresponding requirements for the various pipe types are stated.

Classification of pipes:

The following boundary limits are used for classifying the resistance of piping according to ISO 8031, into the categories given as follows:

Conductive:	resistance per unit length $< 10^3 \Omega \text{ m}^{-1}$
Dissipative	$10^3 \Omega \text{ m}^{-1} \leq$ resistance per unit length $\leq 10^6 \Omega \text{ m}^{-1}$
Insulating:	resistance per unit length $> 10^6 \Omega \text{ m}^{-1}$

The resistance per unit length shall include the effect of one coupling.

More information about electrostatic hazards can be found in Annex B and EN 13463-1.

5.6.2 Requirements for insulating plastic pipe systems

To avoid pin holing insulating plastic pipe should have an electrical breakthrough strength across the pipe exceeding 100 kV, measured in accordance with EN 60243-2. A polyethylene layer of at least 4 mm in thickness usually exceeds this breakthrough strength.

5.6.3 Requirements for plastic pipe systems with conductive or dissipative linings

The conductive liners or conductive layers shall encircle the whole pipe profile and shall be securely electrostatically connected with each other and electrostatically grounded.

5.7 Weathering

Three assemblies consisting of two sections of pipe of minimum length 375 mm and joined by a straight connector shall be preconditioned in accordance to a cumulative solar radiation of $\geq 3,5 \text{ GJ}\cdot\text{m}^{-2}$ using natural weathering in accordance with EN ISO 16871 or artificial weathering by using method A, cycle 1 of Table 3 of EN ISO 4892-2:2013. After exposure the assembly shall show no visible signs of cracking when tested in accordance with 7.2.6. If black PE material is used to manufacture pipe and fittings according to EN 1555-1 to EN 1555-5 and EN 12201-1 to EN 12201-5, this requirement shall be considered as fulfilled.

5.8 Corrosion resistance

All metallic parts that are designed to be directly buried in the ground shall be tested in accordance with EN ISO 11306 by exposure to water and surface sea water to establish the effectiveness of corrosion resistance for an expected life period of 30 years. In addition an assessment shall be made to ensure that adequate external corrosion resistance exists in respect to damage caused by stray electrical currents for the same period of time. The coating of the pipework shall be tested for integrity and holidays with 5 kV mm^{-1} thickness of the coating, but with not more than 20 kV.

NOTE For cathodic protection, see EN 13636.

5.9 Summary of tests

Testing of requirements 5.1 to 5.7 shall be carried out in accordance with Table 3 according to the type.

Table 3 —Tests survey

Test	Clause	Applies to	Type A	Type B	Type CP1 and CS1	Type CS2 and CP2
Hydrostatic pressure at 50°C	7.2.1.1	pipes and fittings to pressures in Table 1	yes	yes	yes	Yes
Hydrostatic pressure at 23°C	7.2.1.2	pipes and fittings to pressures in Table 1	yes	yes	yes	yes
Hydrostatic burst pressure	7.2.1.3	secondary containment CP1 and CP2	—	—	yes (CP1 only)	yes (CP2 only)
Vacuum	7.2.2	pipes and fittings for vacuum suction applications	yes	yes	no	yes
Static electricity	5.6	pipes and fittings	yes	yes	yes	yes
Weathering	5.7	pipes and straight connectors	yes	yes	yes	yes
Corrosion resistance	5.8	all metallic parts designed to be directly buried	yes	yes	yes	yes
Cyclic pressure	7.2.3	pipes and fittings for positive pressure applications	yes	yes	no	no
Crush	7.2.4	pipes and fittings	yes	yes	yes	yes
Bend radius	7.2.5	pipes and straight connectors	yes	yes	yes	yes
Impact	7.2.6	pipes and fittings	yes	yes	yes	yes
Puncture	7.2.7	pipes only	yes	yes	yes	yes
Fuel compatibility	7.2.8	pipes and fittings	yes	yes	yes	yes
Fuel permeability Swelling	7.2.9 7.2.10	pipes only	yes	no	yes	yes
Pull-out	7.2.11	pipes and straight connectors for positive pressure and vacuum suction	yes	yes	no	no
Fitting pull out test	7.2.12	secondary containment CP1 and CP2	—	—	yes (CP1 only)	yes (CP2 only)

6 Production control

A factory production control scheme shall be established and documented in a manual prior to a new product type being placed on the market. Subsequently, any fundamental changes in raw materials and additives, manufacturing procedures or the control scheme that affects the properties or use of a product shall be recorded in the manual.

The manual shall include the factory production control procedures relevant to the declared properties, as confirmed by the initial type tests.

The factory production control procedures shall consist of a system for the permanent internal control of the production of the products to ensure that such products subsequently placed on the market conform to this document and that the measured values conform to the declared values.

The manufacturer shall specify a batch or lot number which shall be marked on the product.

7 Testing

7.1 General items referring to the test methods

7.1.1 Selection of test samples from a product range

Hydrostatic testing to 7.2.1 and, for vacuum suction applications, vacuum testing to 7.2.2, shall be applied to all sizes and types of pipe and fitting.

Where a product with a range of sizes consisting of identical materials and similar design is under test, construct a programme for the remaining tests in which each test is applied to a minimum of two sizes of pipe and fitting.

7.1.2 Number of samples

Three samples shall be used for each test. Unless otherwise specified the samples shall be assemblies consisting of lengths of pipe, one of which shall have a minimum free length of 375 mm or three times the external diameter, whichever is the greater, together with examples of the fittings as appropriate. Fit fittings in accordance with the manufacturer's instructions.

7.1.3 Tests following conditioning

The requirement for hydrostatic pressure testing (5,0 bar or 1,5 bar) and vacuum testing (-0,9 bar) after a conditioning test (7.2.4 to 7.2.11) depends on the application, as detailed in Table 4. Where such testing is required, fit the samples with an end seal at one end and with a pressure fitting at the other. These fittings may be fitted before or after the conditioning test.

After the conditioning test proceed as follows.

If vacuum testing is required, condition the samples in at a temperature of (23 ± 2) °C for not less than 16 h. Then apply to each sample an internal pressure of $(-0,9 \pm 0,05)$ bar [$(0,1 \pm 0,05)$ bar absolute]. Isolate the sample from the vacuum pump and maintain for 5 min at a temperature of (23 ± 2) °C. During this period there shall be no loss of vacuum. Inspect the exterior and, after disassembly, the interior of the sample for signs of leakage or collapse.

If hydrostatic pressure testing is required, fill the samples with water and keep them in an environment maintained at a constant temperature of (23 ± 2) °C for a minimum of 1 h. Apply an internal pressure as defined in Table 4 at the same temperature. Inspect the samples for leaks.

Table 4 — Test pressure after conditioning

Application	Test pressure ^a bar	Test vacuum ^a bar	Test duration min
Primary delivery pipework: positive pressure	$(5,0 \pm 0,1)$	—	5
Primary delivery pipework: vacuum suction including siphons	$(5,0 \pm 0,1)$	$(-0,9 \pm 0,05)$	5
Vent and vapour recovery pipework	$(5,0 \pm 0,1)$	$(-0,9 \pm 0,05)$	5
Fill pipework	$(5,0 \pm 0,1)$	—	5
Secondary containment Type CP1 and CS1	$(1,5 \pm 0,03)$	—	5
Secondary containment Type CP2 and CS2	$(5,0 \pm 0,1)$	—	5

^a All pressures are gauge pressures.

7.1.4 Combined tests

For the sake of efficiency conditioning tests may be combined. For example, the samples may be subjected to the crush, impact and puncture tests in accordance with 7.2.4, 7.2.6 and 7.2.7 respectively before being tested in accordance with 7.1.3. However, if they then fail the test in accordance with 7.1.3 they shall be deemed to have failed all three conditioning tests, unless they can be shown to have passed one or another of the tests separately.

7.1.5 Procedure for retesting

Where one or more failures are noted, the retest protocol in Table 5 shall be adopted.

Table 5 — Retest protocol

Number of failures	Action
0	Product passes the test
1	Retest with 3 new samples If any one of the new samples fails, the product fails the test
2 or 3	Product fails the test

7.1.6 Test Fuels

The test fuels % by volume shall be:

Test Fuel 1: 41,5 % toluene

41,5 % iso-octane

15 % methanol

2,0 % iso-butyl alcohol

Test Fuel 2: 41,5 % toluene

41,5 % iso-octane

17 % methyl tertiary butyl ether (MTBE)

Test Fuel 3: 7,5 % toluene

7,5 % iso-octane

85 % ethanol (in accordance with EN 15376)

Test Fuel 4: bio-diesel B-100 in accordance with EN 14214

7.2 Test methods

7.2.1 Hydrostatic pressure

7.2.1.1 50 °C test

This test is applicable to all pipes and fittings (connected together as one or more assemblies). At least one section of pipe of each diameter shall have a free length of 375 mm.

Fill each assembly with water and place it in a water environment held at a constant temperature of $(50,0 \pm 2,0)$ °C for a minimum of 1 h.

Increase the internal pressure at a steady rate to the lower test pressure specified in Table 1 for the application concerned, over a period of between 30 s and 120 s. Hold the lower test pressure for not less than 5 min. Check for leakage.

7.2.1.2 23 °C test

This test is applicable to all pipes and fittings (connected together as one or more assemblies). At least one section of pipe of each diameter shall have a free length of 375 mm.

Fill each assembly with water and place it in an air or liquid environment held at a constant temperature of (23 ± 2) °C for a minimum of 1 h.

Increase the internal pressure at a steady rate to the lower test pressure specified in Table 1 for the application concerned, over a period of between 30 s and 120 s. Hold the lower test pressure for not less than 5 min. Check for leakage. If leakage is apparent, take suitable corrective action. If no leakage is apparent, increase the pressure at a steady rate until it reaches the higher test pressure specified in Table 1, in a period of not less than 15 s. Hold the higher test pressure for not less than 1 min. Check for leakage.

If desired, the pressure may then be increased until failure occurs.

7.2.1.3 Burst Test

This test is applicable to integral primary/secondary system fittings without continuous 360° separation between the primary containment and secondary containment CP1 and CP2.

Fill the primary section of each assembly with water and place it in an air environment held at a constant temperature of (23 ± 2) °C for a minimum of 1 h.

Increase the internal pressure at a steady rate of 10 ± 1 bar/min until the fitting bursts or reaches the maximum pressure of 50 bar.

Following the primary burst test, there shall be no leakage of water from the primary system to the outside environment.

7.2.2 Vacuum test

This test is applicable to pipework and fittings for vacuum suction.

The test method EN 12294 applies with the following test conditions:

- Test Temperature: (23 ± 2) °C;
- Test Pressure: $(-0,9 \pm 0,05)$ bar ($(0,1 \pm 0,05)$ bar absolute);
- Test Duration: 30 min;

— Preconditioning: ≥ 16 h at (23 ± 2) °C.

Monitor the internal pressure during the test. Inspect the exterior and, after disassembly, the interior of the sample for signs of collapse.

7.2.3 Cyclic pressure test

This test applies to pipework and fittings for positive pressure.

The test method EN 12295 applies with the following test conditions:

- Preconditioning: ≥ 1 h with pipe filled with water at temperature of $(21,5 \pm 3,5)$ °C;
- Test temperature: $(21,5 \pm 3,5)$ °C;
- Test pressure: cycling between 1,0 bar and 4,0 bar above ambient pressure;
- Number of cycles: $1,5 \times 10^6$;
- Cycle rate: between 20 and 25 cycles per minute.

Check the samples for leaks.

7.2.4 Crush test

7.2.4.1 Applicability

This test applies to all pipework and fittings. Both clauses apply.

7.2.4.2 High temperature crush tests

Condition the samples in air at (50 ± 2) °C for not less than 16 h. Remove them from this environment and test them within 5 min.

Measure the outside diameter of the pipe. Place the centre point of each pipe and each fitting, in turn, between two flat plates 150 mm x 150 mm in size, with rounded edges. Apply a compressive force of $(2\ 000 \pm 20)$ N with a ramp rate of (10 ± 1) mm · min⁻¹ for (60 ± 5) s. Measure the outside diameter of the pipe at 5 min \pm 15 s after release of the compressive force.

Inspect the samples for signs of cracking.

Then test the samples in accordance with 7.1.3.

7.2.4.3 Low temperature crush test

Perform the same tests as 7.2.4.2 but condition the samples at (-40 ± 2) °C for Temperature Class T1 or (-20 ± 2) °C for Temperature Class T2. Remove the samples from this environment and test them within 5 min.

7.2.5 Bend radius test

7.2.5.1 Choice of method

This test applies to all pipes and straight couplers. The samples shall consist of sections of pipe at least 1,4 m long or, if a straight coupler is included, two lengths each 0,7 m long connected by a straight coupler at the centre.

Either Method 7.2.5A or Method 7.2.5B shall be applied. Method 7.2.5A is preferred. Where the force required to bend the specimen is too great to be applied manually apply Method 7.2.5B.

If the product has a natural bend the samples shall be bent to the specified radius in the direction opposite to the natural bend.

7.2.5.2 Method 7.2.5A

Condition the samples in air at $(-40 \pm 2)^\circ\text{C}$ for Temperature Class T1 or $(-20 \pm 2)^\circ\text{C}$ for Temperature Class T2. Remove the samples from this environment and test them within 5 min. Bend each sample round a former to a radius of curvature equal to the smallest radius stated in the installation manual for a minimum of 10 s.

7.2.5.3 Method 7.2.5B

Condition the samples in air at $(-40 \pm 2)^\circ\text{C}$ for Temperature Class T1 or $(-20 \pm 2)^\circ\text{C}$ for Temperature Class T2. Remove the samples from this environment and test them within 5 min. Place the sample on two supports a minimum of 1 m apart and apply a deflection at its centre using a mechanical testing machine. The value of this deflection shall be calculated to produce the minimum bend radius at the centre of the span in accordance with the formula $y = L^2/12R$, where L is the distance between the supports, R the required bend radius and y the deflection to be applied. Maintain this deflection for a minimum of 10 s.

7.2.5.4 Evaluation

After testing to Method 7.2.5A or Method 7.2.5B inspect the samples for signs of damage or cracking.

Then the samples shall be tested in accordance with 7.1.3.

7.2.6 Impact test

This test applies to all pipework and fittings.

Condition the samples in air at $(-40 \pm 2)^\circ\text{C}$ for Temperature Class T1 or $(-20 \pm 2)^\circ\text{C}$ for Temperature Class T2. Remove the samples from this environment and test them within 5 min. Place the samples on a flat surface or in a 'V' block directly supporting the pipe or fitting below the point of impact and at the same temperature. Impact each pipe at its centre point, and each fitting, with a (50 ± 1) mm diameter hemispherical striker weighing $(0,5 \pm 0,03)$ kg, dropped from a height of $(1,8 \pm 0,05)$ m.

Inspect the samples for signs of cracking.

Then the samples shall be tested in accordance with 7.1.3.

7.2.7 Puncture resistance

7.2.7.1 Applicability

This test applies to all pipes. Both clauses apply.

7.2.7.2 Ambient temperature puncture test

Condition the samples in air at $(23 \pm 2)^\circ\text{C}$ for not less than 16 h. Place each sample on a rigid surface and apply a (500 ± 10) N load by means of a loading tip perpendicular to the outer surface for not less than 10 s. The loading tip shall be rectangular, with dimensions of $(6,35 \pm 0,1)$ mm x $(2,00 \pm 0,1)$ mm, with edges rounded to a radius of $(0,5 \pm 0,1)$ mm. Apply the load at two points, (100 ± 10) mm apart, approximately in the centre of the sample, once with the tip longitudinal to the pipe direction, once with the tip parallel to the pipe direction. Alternative orientations are acceptable provided that they relate to the structure of the pipe wall.

Then the samples shall be tested in accordance with 7.1.3.

7.2.7.3 Low temperature puncture test

Perform the same tests as 7.2.7.2 but condition the samples at (-40 ± 2) °C for Temperature Class T1 and (-20 ± 2) °C for Temperature Class T2. Remove the samples from this environment and test them within 5 min.

7.2.8 Fuel compatibility test

7.2.8.1 Principal test

This test applies to all pipes and fittings.

For all pipes and fittings place the samples in a container and immerse them in Test Fuel 2 in accordance with 7.1.6 with both their inner and outer surfaces exposed to the fuel. Allow an air gap for expansion of the fuel. Seal the container. Ensure that the end-closures used for pressure testing are sufficiently resistant to fuels.

Place the samples or containers in an environment maintained at (50 ± 2) °C for a period of 30^{+2} days.

Condition the unexposed samples at the same temperature and duration as stated above. After ageing, cool the container to ambient temperature, remove the fuel and examine the samples internally and externally by eye without magnification for signs of damage or swelling, for example of seals, which could impair correct functioning of the pipework.

Then test the samples in accordance with 7.1.3, except that the samples shall be kept in an environment maintained at a constant temperature of (23 ± 2) °C for (2 ± 1) h [i.e. with a maximum limit of 3 h] before testing. In addition, on completion of the tests following conditioning (7.1.3), for pipes with a multi-layer construction, perform either test in accordance with 7.2.8.2.2 or 7.2.8.2.3.

Manufacturers may choose to conduct additional testing, e.g. with specific alcohols, aromatics and ethers, as appropriate, to provide additional confidence in their pipework. This testing shall be recorded in the technical file.

7.2.8.2 Peel test

7.2.8.2.1 General

When two or more layers are part of a multilayer construction, it shall be defined:

Flexible-Flexible layers: when both layers can be bent up to 90° without breaking or cracking.

Flexible-Rigid layers: when only one layer of the multilayer construction can be bent up to 90° or more without breaking or cracking.

7.2.8.2.2 Peel test A, Flexible-Flexible

This test applies to pipes with a multi-layer construction where the layers are Flexible-Flexible.

Five samples shall be taken from the exposed pipe and five from the unexposed pipe. Each group of five shall be tested in accordance with EN ISO 11339. Testing shall be performed within two days of completion of the fuel compatibility test.

7.2.8.2.3 Peel test B, Flexible-Rigid

This test applies to pipes with a multi-layer construction where the layers are Flexible-Rigid.

Five samples shall be taken from the exposed pipe and five from the unexposed pipe. Each group of five shall be tested in accordance with EN 28510-1 and EN ISO 8510-2. Testing shall be performed within two days of the completion of fuel compatibility test.

7.2.9 Fuel permeability test

7.2.9.1 Applicability and general provisions

This test applies to pipes of Types A, CS1, CP1, CS2, CP2. Method 7.2.9A shall normally be applied. Method 7.2.9B may be applied in order to reduce the time of testing. Experience has shown that the rate of mass loss measured using Method 7.2.9B generally exceeds that measured using Method 7.2.9A. In the event of dispute Method 7.2.9A shall be regarded as definitive.

The method chosen shall be applied using four test fuels separately: Test Fuel 1, Test Fuel 2, Test Fuel 3, and Test Fuel 4 (see 7.1.6).

7.2.9.2 Method A

A sample consists of a length of pipe (450 ± 50) mm long, with a maximum Outside Diameter of 63 mm. Each pipe end shall be sealed with suitable end-closures for the duration of the test.

Standard end-closures used for pressure testing are unlikely to be suitable. The end-closures used for the permeation test will need to be fitted with FPM, e.g. Viton F, seals. The test fuels have been specially selected for their volatile nature, so that multiple seals may be required to ensure that loss through the end-closures is negligible.

Close the pipe at one end. Fill it with the appropriate test fuel to $> 90\%$ of full volume, allowing a limited air gap for expansion of the fuel. Seal the pipe at the other end. Measure the exposed length of the pipe, L , i.e. excluding the length of the end closures either on the inside or the outside of the pipe, and the mean external diameter, D .

Store the samples in air at $(23 \pm 2)^\circ\text{C}$ and re-weigh approximately every seven days, using a balance calibrated to an accuracy of $\pm 0,1$ g or better.

Plot mass loss against time. After the end of an incubation time of 313 days, continue the test for a further seven weeks with at least eight measurement points and fit a regression line. At least six of the points, including those at each end of the linear section, shall deviate from the regression line by no more than $\pm 0,2$ g.

Determine the rate of mass loss of the 'steady state' period (gradient of the regression line) in $\text{g}\cdot\text{d}^{-1}$. Calculate the surface area A , where $A = \pi \cdot L \cdot D$, in m^2 . Divide the rate of mass loss by A to give the permeation rate in $\text{g}\cdot\text{m}^{-2}\cdot\text{d}^{-1}$ for each specimen.

7.2.9.3 Method B. Accelerated fuel permeability test

This method is the same as Method 7.2.9A except that the sealed samples are placed in an environment at $(50 \pm 2)^\circ\text{C}$ and their mass measured at least twice every seven days. The 'steady state' period shall last for at least 21 days with at least eight test points. After this has been achieved remove the samples to an environment at $(23 \pm 2)^\circ\text{C}$. Then proceed as in Method 7.2.9 A. Calculate and report the rate of mass loss at 23°C .

7.2.10 Longitudinal swelling

This test applies to pipes of Types A, CP1, CS1, CP2, CS2 and should be performed simultaneously with Method A or B according to 7.2.9.

After filling the pipe with the test fuel make two marks at either end of the pipe such that the line between them is parallel to the axis. Measure the length between the two marks to the nearest 0,1 mm.

Each time the pipe is weighed measure the length between the two marks.

Take the final measurement of length from the end of permeation test. From this measurement determine the elongation as a percentage of the initial length.

7.2.11 Pull-out test

This test applies to pipes and straight connectors for positive pressure and vacuum suction.

A sample consists of either two transition fittings separated by a section of pipe of minimum length 375 mm, or two sections of pipe connected by a straight connector with a transition fitting at each end of the assembly.

A linkage shall be provided such that axial load can be applied to the transition fittings by a mechanical testing machine.

The length of each sample shall be sufficient to allow the assembly to be connected to a mechanical testing machine capable of applying a gradually increasing tensile load and to end-closures suitable for pressure testing.

Condition the samples in air at (23 ± 2) °C for not less than 16 h. Connect them to the mechanical testing machine. Apply a tensile load as follows:

- $(4\ 000 \pm 40)$ N for pipes up to and including 63 mm diameter;
- $(7\ 500 \pm 75)$ N for larger pipes.

Apply the load gradually over a period of (30 ± 10) s, and maintain the full load for not less than 5 min.

The samples shall be inspected for signs of slippage.

Then the samples shall be tested in accordance with 7.1.3.

7.2.12 Fitting Pull-out test

This test is applicable to secondary containment CP1 and CP2.

Apply an axial load to the Primary Section of the fitting while restraining the secondary containment part. Axial load should be as shown below:

- $(4\ 000 \pm 40)$ N for primary sizes up to and including 63 mm diameter.
- $(7\ 500 \pm 75)$ N for primary sizes up above 63 mm diameter.

Following application of the load, primary and secondary containment shall be pressure tested independently in accordance with 7.2.1.2 of the standard.

8 Markings on pipe and fittings

Pipes shall be permanently and indelibly marked with their identity, traceability and intended application as shown in Table 6. Fittings shall be marked in the same way, or supplied with a permanent label containing traceability data.

Table 6 — Marking

Aspects	Mark or symbol
Number of the system standard	EN 14125
Manufacturer's name or trade mark	
External or internal diameter in mm	DN/OD *** or DN/ID ***** mm
Type	Type A or B
Application	PP/VA/VE/VR/FI/CS1/CS2/CP1/CP2 (see NOTE 1)
Temperature Class	T1 or T2
Resistance classification	C, D or I (see NOTE 3)
Manufacturer's information	**./**** (see NOTE 2)
<p>NOTE 1 <i>PP: positive delivery</i> <i>VA: vacuum delivery</i> <i>VE: vent pipework</i> <i>VR: vapour recovery pipework</i> <i>FI: fill pipework</i> <i>CS1: See 4.1</i> <i>CP1: See 4.1</i> <i>CS2: See 4.1</i> <i>CP2: See 4.1</i></p> <p>NOTE 2 <i>For providing traceability the following details are required: batch or lot number, year, and a name or code for the production site if the manufacturer is producing in different sites, nationally and/or internationally.</i></p> <p>NOTE 3 <i>C: conductive</i> <i>D: Dissipative</i> <i>I: Insulating</i></p>	

The marking elements shall be printed or formed directly on the pipe or on the fitting in such a way that after storage, weathering, handling and installation in accordance with the manufacturer's instructions, legibility is maintained during the use of the products. The maximum interval between successive markings on pipe shall be 1 m. Where the size of fitting makes marking impractical the marking shall be made on a sealed package containing the fitting.

Marking shall not initiate cracks or other types of defects which would impair conformity to the requirements of this document.

If printing is used, the colouring of the printed information shall differ from the basic colouring of the pipe.

The size of the marking shall be such that the marking is legible without magnification.

9 Manuals

9.1 Product manual

Manufacturers of pipe systems shall make available a manual covering:

- correct applications for pipework and fittings;
- estimated working life;

- static electricity. The manufacturers shall describe necessary precautions how the pipework shall be operated to prevent accumulation of static electricity. The precautions shall consider the requirements in accordance with Annex B and EN 13463-1. Reference shall be made to specific national regulations.

9.2 Installation manuals

Manufacturers shall make available a written manual covering:

- transport, storage and handling;
- static electricity. The manufacturers shall give guidance on any necessary precautions that their pipework may need to prevent accumulation of static electricity. The precautions shall consider the requirements in accordance with Annex B and EN 13463-1;
- protection against weathering;
- bend radius;
- tools or equipment;
- maintenance;
- safety;
- check list of actions to achieve correct installation;
- installation testing;
- proper back filling.

Consideration should be given to providing the manual in the user's language.

10 Records

The manufacturer shall maintain a technical file containing details of the materials used, the necessary data on their long-term performance, plus any calculations and supporting data necessary to relate this to the design of the pipe, e.g. wall thickness.

Unless otherwise specified, all records shall be maintained for a minimum of 10 years.

MAHCO

Annex A (informative)

A-deviations

A-deviation: National deviation due to regulations, the alteration of which is for the time being outside the competence of the CEN/ CENELEC member.

European Standard not under any EU Directive

This document does not fall under any Directive of the EU. In the relevant CEN/CENELEC countries these A-deviations are valid instead of the provisions of the European Standard until they have been removed.

Austria

Verordnung für brennbare Flüssigkeiten

Bundesgesetzblatt Nr. 354/1993; § 20

In addition to the requirements of this document, the following is valid in Austria:

"The use of products for transport of flammable liquids is restricted to durable and impermeable products in general."

Therefore the following requirements shall be fulfilled:

As stated in EN 14125, Table 2, for delivery pipework for fuel permeability the allowable tolerance is stated in the range of $-0 \text{ g}\cdot\text{m}^{-2}\cdot\text{d}^{-1}$ to $+0,2 \text{ g}\cdot\text{m}^{-2}\cdot\text{d}^{-1}$. With respect to this and having in mind the provision mentioned above the following has to be stated:

In accordance with Austrian law and in particular with respect to pipes Type A in accordance with 4.1 in EN 14125 in Austria for transport of fuel the use of pipes with permeability $> 0 \text{ g}\cdot\text{m}^{-2}\cdot\text{d}^{-1}$ is forbidden.

Germany

— Gesetz zur Ordnung des Wasserhaushalts (Wasserhaushaltsgesetz - WHG)

Ausgabe 07/2009: Paragraph 62 Absatz (1),

In addition to the requirements of this document the following is valid in Germany:

(1) Anlagen zum Lagern, Abfüllen, Herstellen und Behandeln wassergefährdender Stoffe sowie Anlagen zum Verwenden wassergefährdender Stoffe im Bereich der gewerblichen Wirtschaft und im Bereich öffentlicher Einrichtungen müssen so beschaffen sein und so errichtet, unterhalten, betrieben und stillgelegt werden, dass eine nachteilige Veränderung der Eigenschaften von Gewässern nicht zu besorgen ist. Das Gleiche gilt für Rohrleitungsanlagen, die

- 1) den Bereich eines Werksgeländes nicht überschreiten,
- 2) Zubehör einer Anlage zum Umgang mit wassergefährdenden Stoffen sind oder
- 3) Anlagen verbinden, die in engem räumlichen und betrieblichen Zusammenhang miteinander stehen.

Therefore the following requirements shall be fulfilled:

The underground pipework shall have a permeation of $0 \text{ g}\cdot\text{m}^{-2}\cdot\text{d}^{-1}$. Metallic pipework shall be considered as a pipework with $0 \text{ g}\cdot\text{m}^{-2}\cdot\text{d}^{-1}$.

The Netherlands

Directive Petrol Stations Environmental Control dated 20th January 1994 /Besluit Tankstations Milieubeheer d.d. 20 januari 1994

CPR 9-1:1993 Guideline 9-1 prepared by the Committee for Prevention of Disasters caused by dangerous substances with the title "Liquid petroleum products: underground storage in steel tanks and dispensers for motor fuels" /CPR 9-1:1993 Richtlijn 9-1 van de Commissie Preventie van Rampen door Gevaarlijke Stoffen getiteld "Vloeibare aardolie producten: ondergrondse opslag in stalen tanks en afleverinstallaties voor motorbrandstof"

CPR 9-6:1993 Guideline 9-6 from the Commission for Prevention of Disasters caused by dangerous substances with the title "Liquid petroleum products: storage up to 150 m³ of flammable fluids with a flash point from 55 to 100 °C in above ground storage tanks" /CPR 9-6:1993 Richtlijn 9-6 van de Commissie Preventie van Rampen door Gevaarlijke Stoffen getiteld "Vloeibare aardolie producten: opslag tot 150 m³ van brandbare vloeistoffen met een vlammpunt van 55 tot 100 °C in bovengrondse tanks"

The above guidelines CPR 9-1 and CPR 9-6 were retitled PGS 28 and PGS 30 "Publication series Dangerous Goods" as per 1st June 2004 with identical status

Based on the above legislation thermoplastic piping systems for the transport of liquid oil products and their vapours shall conform to the requirements of BRL-K552.

Specifically, the following requirement shall be fulfilled:

The maximum permeation rate of the complete piping system (including fittings, sealing rings, etc.) shall not exceed 150 mg/24 h per length of pipe from tank to pump.



Annex B (informative)

Static Electricity

B.1 General

Fuel handling operations at retail filling stations involve both the delivery of fuel into underground tanks at the station, usually from road tankers, and the dispensing of fuel from the underground tanks into customer's vehicles. Flash fires initiated by static electricity have occurred both whilst delivering fuel into the underground tanks and whilst dispensing gasoline to customer vehicles.

The production of explosive atmospheres during both delivery and dispensing operations depends on the fuel type. Based on the Flash Point of diesel fuel being at least 58 °C, diesel fuel vapours are usually too lean for combustion at ambient temperatures although hot diesel return lines on the vehicle may sometimes produce an explosive atmosphere within the vehicle tank. However, some countries permit diesel fuel to have a significantly lower flash point. In these countries diesel vapours may produce flammable mixtures at high ambient temperatures.

In contrast, gasoline vapour mixtures are generally too rich for combustion in enclosed spaces such as fuel tanks but may come into the explosive range where mixing with fresh air is possible (e.g. when fuelling a vehicle with gasoline there will always be a place near the filler inlet where the mixture strength is at the optimum for ignition, consequently, an electrostatic discharge near the filler inlet could lead to a fire and burn the person filling the vehicle). Ethanol-gasoline mixtures with high concentrations of ethanol may produce explosive atmospheres within closed tanks at standard ambient temperatures although these fuels are less likely to become electrostatically charged because of their high conductivity.

Based on the above, explosive atmospheres may occur in the following situations:

- inside gasoline-ethanol (e.g. E85) tanks or drained pipes,
- inside gasoline pipes when air is drawn in after hoses are disconnected following a delivery
- around gasoline filler openings during refuelling, outside gasoline or gasoline-ethanol pipes due to leaks or spillage, particularly in enclosed underground "sumps" or "fill boxes" where the underground pipes are connected to tanks or truck hoses. Gasoline and diesel pipes are often housed in the same fill box so it is conceivable for a leak from the gasoline line to produce an explosive atmosphere that could be ignited during diesel loading.

The fuel at filling stations varies from low conductivity hydrocarbons blends without static dissipative additive (SDA) to high conductivity blends of oxygenated bio-components (e.g. ethanol) and hydrocarbons. Even with the low conductivity fuels, the flow rates are sufficiently small to prevent hazardous potentials being generated by the accumulation of charge on the liquid either in the underground storage tanks or in the fuel tanks on customer vehicles.

However, if any of the conductors associated with the operations (e.g. the filler nozzle, pipe couplings, the vehicle being filled, the filler neck, or a person) are electrically isolated, charge accumulation on the isolated item could then give rise to incendive spark discharges. Also, charges accumulating on insulating pipes or other insulating components in the handling system could produce incendive brush discharges. An ignition could occur if any of these discharges occurred in an explosive atmosphere (see above). The precautions listed in B.2 should be taken to avoid electrostatic ignitions in fuel delivery to underground tanks.

B.2 Delivering fuels to underground tanks

B.2.1 Systems with metal pipes

- a) All pipe sections should be earthed in a manner that does not risk introducing electrical fault currents into the piping system (e.g. with a suitable isolating resistance)
- b) The earthing should be regularly checked.
- c) Equipment such as fine filters that may give enhanced fuel charging should be used only if there is enough relaxation time in the conductive pipe.

B.2.2 Systems with plastic pipes

Plastic pipes are increasingly being used for fuel delivery from road tankers to underground tanks, from underground tanks to fuel dispensers, and for vapour recovery lines and vents because they provide improved corrosion resistance and secondary containment.

Two main varieties of plastic pipe system are in use: the so-called “non-conductive” (insulating) pipes and the so-called “conductive” pipes (non-conductive pipes incorporating co-extruded dissipative inner linings). Typical plastic pipe systems use connectors which incorporate metal heating coils (electrofusion couplers, EFCs) to couple and seal pipe lengths and joints. These EFCs may have an installed capacitance of between 5 pF and 30 pF depending on the installation. Plastic pipes normally incorporate a co-extruded inner lining for countering fuel permeation. For pipes that also have a dissipative lining, the dissipative lining is usually the innermost.

Specific risks in these types of systems include

- a) Fuel flow could cause significant charging of low or medium conductivity fuels. Consequently:
 - 1) For fully insulating (“non-conductive”) pipes:
 - i) High voltages could build up on unburied pipe walls or on associated non-earthed connectors.
 - ii) Discharges can occur on the inner surface of a charged pipe. The fill point where the hose from the lorry is attached is a critical point in this respect because discharges to earthed connectors or couplings or from highly charged to less charged plastic surfaces may cause ignition if air ingress occurs on disconnection.
 - iii) The electrostatic fields arising from the build-up of charge on the pipe wall could cause high voltages to arise on nearby conductive EFCs, tools, and other items outside pipes and cause spark discharges to nearby earthed conductive items.
 - iv) High electric fields could occur in the walls of buried pipes leading to possible breakdown and pinholing by electrostatic discharges.
 - 2) For insulating pipes with dissipative liners (so-called “conductive pipes”):
 - i) Charge cannot accumulate if the lining is earthed, and the shielding provided by an earthed lining minimises the risk of flow-related high voltages on associated conductors such as EFCs.
 - ii) However, voltages may build up on any unearthed liner sections or on the connectors associated with them.
- b) Charging of external insulating pipe surfaces by rubbing could give brush discharges.

- c) Mixing of insulating and conductive pipes in a system could lead to isolated conductive parts. It is acceptable only if all conductive parts are certain to be earthed. Particular attention should be paid to earthing metal flanges, couplings and clips on insulating segments and earthing the lining of the conductive segments.
- d) Where pipes are fitted during maintenance of a system, when a flammable atmosphere could be present, specific risks may arise. Both conductive and insulating pipes may charge during handling and give potentially incendive discharges.
 - 1) For insulating pipes, incendive brush discharges from the outer pipe surface are possible.
 - 2) For pipes with dissipative liners, the accumulated surface charge could induce high voltage on an erroneously un-earthed liner and this could be the source of shocks to people and incendive discharges.

The voltage build-up on insulating pipes from fuel charging depends on flow speed, fill volume and the length of unburied sections as well as on pipe and fuel properties. The variability of these charging characteristics and the variation of charge dissipation characteristics with age and temperature is still not well understood. Wide safety margins for dissipation should, therefore, be applied until the worst-case charging characteristics are better known.

There is, however, a considerable installed base of pipes and there are only few recorded incidents so existing practices seem to be broadly acceptable with today's fuels. It is, however, unclear whether existing practices would continue to provide adequate safety margins if the increasing use of oxygenated biocomponents in gasoline were to give rise to higher charging.

NOTE There are indications that at least some ethers and esters are prone to higher charging than hydrocarbon fuels.

In order to prevent excessive electrostatic charge and voltage build-up on the pipe walls, valves and couplings the following precautions are recommended:

- e) Insulating plastic pipes
 - 1) To avoid pin holing insulating plastic pipes should have an electrical breakthrough strength across the pipe exceeding 100 kV, measured according to EN 60243-2. A polyethylene layer of at least 4 mm in thickness usually exceeds this breakthrough strength.
 - 2) Unburied EFCs should be either long-lasting and reliably earthed or sealed using airtight seals.
 - 3) All other conductive parts of pipes or joints should be earthed.
 - 4) The earthing of all conductive and dissipative items should be regularly checked.
 - 5) Unburied fully insulating plastic pipe sections should be kept as short as practicable.
 - 6) Fuel flow rates should be limited to < 2,8 m/s.

The possible future introduction of bio-components may change the charging behaviour of fuel.

- 7) The earthing of the majority of each pipe by burial contributes significantly to the safe operation of the system. Consequently, following installation or repair, liquid should not be admitted into a pipe until all sections that are intended to be buried are confirmed to be fully covered with earth.
- 8) Equipment such as fine filters that may give enhanced fuel charging should be used only with careful assessment of the likely hazards.

- 9) The fill point where the truck hose is attached should use a safety connection valve, preferably an interlocked system, that does not allow air to enter the system and mix with the fuel vapours, e.g. a valve that is closed before disconnecting hose and pipe.
 - 10) The exposure of pipes and joints in sumps where flammable vapours could accumulate should be minimised.
 - 11) People should avoid brushing against external pipe surfaces where a flammable vapour may be present.
 - 12) During system maintenance, care should be taken to avoid introducing a highly charged pipe into a flammable atmosphere.
- f) Plastic pipes with dissipative linings
- 1) The linings should be earthed. An earthed, dissipative liner prevents internal discharges and screens external conductors from flow charging.
 - 2) Earthing may be achieved by a suitable arrangement of dissipative internal couplings linking to external grounding points.
 - 3) The earthing of all conductive and dissipative items should be regularly checked.
 - 4) Equipment such as fine filters that may give enhanced fuel charging should be used only with careful assessment of the likely hazards.
 - 5) During system maintenance, care should be taken to avoid introducing a highly charged pipe into a flammable atmosphere. Dissipative liners should be grounded before the pipe is introduced into a flammable atmosphere and the ground connection should be maintained during the fitting process, until the liner is reliably grounded via the installed system.

People should avoid brushing against external pipe surfaces where a flammable vapour may be present.

MAHCO

Bibliography

- [1] EN 2243-2, *Aerospace series — Non-metallic materials — Structural adhesives — Test method — Part 2: Peel metal-metal*
- [2] EN 13480-1, *Metallic industrial piping — Part 1: General*
- [3] EN 13480-2, *Metallic industrial piping — Part 2: Materials*
- [4] EN 13480-3, *Metallic industrial piping — Part 3: Design and calculation*
- [5] EN 13480-4, *Metallic industrial piping — Part 4: Fabrication and installation*
- [6] EN 13480-5, *Metallic industrial piping — Part 5: Inspection and testing*
- [7] EN 13480-6, *Metallic industrial piping — Part 6: Additional requirements for buried piping*
- [8] EN 13636, *Cathodic protection of buried metallic tanks and related piping*
- [9] EN 45012, *General requirements for bodies operating assessment and certification/registration of quality systems (ISO/IEC Guide 62:1996)*
- [10] EN 60243-1, *Electrical strength of insulating materials — Test methods — Part 1: Tests at power frequencies (IEC 60243-1)*
- [11] EN 60243-2, *Electrical strength of insulating materials — Test methods — Part 2: Additional requirements for tests using direct voltage (IEC 60243-2)*
- [12] EN 61340-5-1, *Electrostatics — Part 5-1: Protection of electronic devices from electrostatic phenomena — General requirements (IEC 61340-5-1)*
- [13] EN ISO 9001, *Quality management systems — Requirements (ISO 9001)*
- [14] EN ISO 9080, *Plastics piping and ducting systems — Determination of the long-term hydrostatic strength of thermoplastics materials in pipe form by extrapolation (ISO 9080)*
- [15] ISO 1817, *Rubber, vulcanized or thermoplastic — Determination of the effect of liquids*
- [16] ISO 6259-3, *Thermoplastic pipes — Determination of tensile properties — Part 3: Polyolefin pipes*
- [17] ISO 17456, *Plastics piping systems — Multilayer pipes — Determination of long-term strength*
- [18] DIN IEC 60093, *Methods of test for insulating materials for electrical purposes; volume resistivity and surface resistivity of solid electrical insulating materials (IEC 60093:1980); German version HD 429 S1:1983*
- [19] Pressure Equipment Directive (PED) 97/23/EC Directive 97/23/EC of the European Parliament and of the Council of 29 May 1997 on the approximation of the laws of the Member States concerning pressure equipment



British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email bsmusales@bsigroup.com.

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

Useful Contacts:

Customer Services

Tel: +44 845 086 9001

Email (orders): orders@bsigroup.com

Email (enquiries): cservices@bsigroup.com

Subscriptions

Tel: +44 845 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK



MEHR AB HAYAT SANAAT KERMAN
www.MAHCOpipe.com

...making excellence a habit.™